

# Panic & emergency exit devices

**CFPA-E Guideline No 2:2013 F**





## **FORWORD**

The European fire protection associations have decided to produce common guidelines in order to achieve similar interpretation in the European countries and to give examples of acceptable solutions, concepts and models. The Confederation of Fire Protection Associations Europe (CFPA E) has the aim to facilitate and support the fire protection work in the European countries.

This Guideline refers only to exit devices, which comply with the European standards for, panic and emergency exit devices, EN 1125 and EN 179.

The guideline applies where the activity imposes demands on doors, not sliding doors, which shall be normally kept locked from the outside and/or prevent the passage of unauthorised persons, and shall also be capable of use as means of escape.

The guideline is primarily intended for those responsible for safety in companies and organisations. It is also addressed to the installation firms, rescue service, consultants, safety companies, architects etc so that, in the course of their work, they may find it useful to have access to different functional solutions with exit devices complying with European standards.

The proposals within this guideline have been produced by the Swedish Fire Protection Association and the author is Lars Rang from Sweden.

This guideline has been compiled by Guidelines Commission and adopted by all fire protection associations in the Confederation of Fire Protection Associations Europe.

These guidelines reflect best practice developed by the countries of CFPA Europe. Where the guidelines and national requirement conflict, national requirements must apply.

Copenhagen, 7 mars 2013  
CFPA Europe

Jesper Ditlev  
Chairman

Helsinki, 7 mars 2013  
Guidelines Commission

Matti Orrainen  
Chairman





## Contents

1	Introduction .....	4
2	Panic or emergency? .....	5
2.1	Panic situations.....	5
2.2	Emergency situations .....	5
3	Fields of application .....	5
3.1	Panic exit devices.....	6
3.2	Emergency exit devices .....	6
3.3	Other opening devices.....	6
4	Pairs of doors .....	7
5	Emergency exit knob.....	7
6	Intruder protection locking device .....	8
7	Operation and maintenance .....	8
8	Choice of exit device for locked door as a function of the activity .....	9
8.1	Table for choosing exit devices.....	10
9	Definitions.....	12
10	European guidelines.....	13
11	Appendix No: 1.....	15
11.1	DOOR N 1, Single fire door .....	16
11.2	DOOR N 2, Single door, not a fire door .....	17
11.3	DOOR N 3, Single door with/without fire separating function depending on choice of electric striking plate .....	18
11.4	DOOR N 4, Single fire door .....	19
11.5	DOOR N 5, Single door with/without fire separating function depending on choice of electric striking plate .....	20
11.6	DOOR P 1, Single fire door.....	21
11.7	DOOR P 2, Single fire door.....	22
11.8	DOOR P 3, Single fire door.....	23
11.9	DOOR P 4, Single door with/without fire separating function depending on choice of electric striking plate.....	24
11.10	DOOR P 5, Single fire door.....	25
11.11	DOOR P 6, Single fire door.....	26
11.12	DOOR NP 1, Pair of fire doors .....	27
11.13	DOOR NP 2, Pair of doors with no fire separating function .....	28
11.14	DOOR NP 3, Pair of doors with/without fire separating function depending on choice of electric striking plate .....	29
11.15	DOOR NP 4, Pair of fire doors .....	30
11.16	DOOR NP 5, Pair of doors with/without fire separating function depending on choice of electric striking plate .....	31
11.17	DOOR PP 1, Pair of fire doors.....	32
11.18	DOOR PP 2, Pair of fire doors.....	33
11.19	DOOR PP 3, Pair of fire doors.....	34
11.20	DOOR PP 4, Pair of doors with/without fire separating function depending on choice of electric striking plate..	35
11.21	DOOR PP 5, Pair of fire doors.....	36
11.22	DOOR PP 6, Pair of fire doors.....	37
12	EXAMPLES OF CONTROL ROUTINES.....	38
12.1	Control routines .....	38

Key words: emergency exit, emergency exit device, panics exit device, escape,




## 1 Introduction

This proposal for functional solutions is mainly based on European standards for panic and emergency exit devices, EN 1125 and EN 179.

The Guideline applies for doors in escape routes, with or without fire separating function, which normally shall be kept locked from the outside and/or provide the means of controlling the passage of persons from the inside/outside.

For other doors in escape routes, which are **not** covered by this Guideline, a different opening function can be used or after other national regulations.

Example

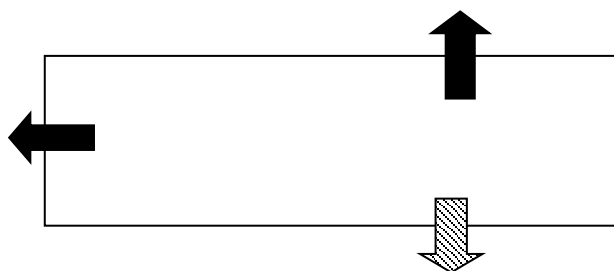

Exit doors which shall normally be kept locked from the outside and/or provide the means of controlling the passage of persons from the inside/outside. Examples of these doors are given in this Guideline.



Exit doors which shall normally **not** be kept locked from the outside and/or provide the means of controlling the passage of persons from the inside/outside. For these doors other fittings can also be used.

Appendix No 1 gives examples of exit devices which can be used on doors to escape routes, where the activity demands that it should normally be possible for these doors to be kept locked from the outside to prevent the passage of unauthorised persons.

The publication does not deal with the fundamental problems of how to identify the doors, which are exit doors. For the applicable requirements, reference is to be made to the laws, regulations and other publications in the country concerned.



## **2 Panic or emergency?**

When designing equipment for exit doors on escape routes, you should always ask the question: is there any chance that a panic situation may arise?

Often, of course, building regulations, fire safety requirements, etc. will give you formal guidance or will even require the use of special hardware. However, the designer should take all possible measures to reduce the consequences of potential risks that may occur in the lifespan of a building. Technical solutions to deal with panic situations and with 'ordinary' emergencies are different. It is therefore important to define what type of situation is likely to arise.

### **2.1 Panic situations**

The reactions of a large number of people are always difficult to predict, especially in the event of a fire in a cinema, a restaurant etc. The chances are that many of them will behave irrationally. The individuals exposed to such a panic situation must be able easily to find the hardware located on the exit door and how to operate it, and must not need any special tool or key, which may not be available.

The exit hardware must be designed to perform correctly in even the most extreme situations, in order to allow panicking people to exit. For example, when two or more people are rushing to an exit door located on an escape route, probably in darkness and/or smoke, it is possible that the first one to reach the door will not necessarily operate the panic exit device, but can push the surface of the door (door under pressure) while other people will be trying to operate the horizontal bar by hand or body pressure.

### **2.2 Emergency situations**

Typically, panic will not arise in hazardous situations involving a smaller number of people. Especially not if these people are familiar with the premises and with the emergency exits and their hardware. This could be the case in offices or other working environments.

Information, training, etc. will allow people to act rationally and to overcome their fears when exposed to a threatening situation. A clear understanding of the means of escape will allow positive and reasonable reactions, thus making a clear choice possible: where to go, what door to use, how to operate the door, etc. Of course, it is necessary here too that the door will operate without using any special tool or key, since this may not be available immediately.

## **3 Fields of application**

The fields of application listed below are to be seen as a guide to specifying exit devices. In each individual project, consideration should be given to the layout of the escape routes and premises and their fields of application. Even temporary use of the premises for purposes other than their normal activity may affect the choice of exit devices, e.g. when a sports hall is used for a school dance. Consideration should also be given to the possible future use of the premises, so that



provision may be made at an early stage for flexible use. This implies that in certain circumstances the devices should be designed for a greater number of people, with variable knowledge of the premises, than those in the activity that is normally carried on in the premises.

The terms large number, smaller number and few are not defined in numbers of people, but shall be seen as a guide and a basis for assessment of the building as a whole or of the individual premises.

### **3.1 Panic exit devices**

Appropriate devices in premises and buildings where a large number of people, without good knowledge of the premises, may be present at the same time. Examples are schools, shopping centres, hospitals, theatres, discotheques, sports facilities, and restaurants.

Consideration should be given to the layout of the building and the premises, as well as the number of escape routes and their characteristics.

The publication refers to panic bolts, which comply with the requirements in European Standard EN 1125.

### **3.2 Emergency exit devices**

Appropriate devices in premises and buildings where a smaller number of people are present and where they cannot all be presumed to have good knowledge of the premises. Examples are offices and medium sized places of assembly.

These are recommended as the lowest level for exit doors where panic exit devices are not required.

The publication refers to emergency exit devices with single action operation, which comply with the requirements in European Standard EN 179.

### **3.3 Other opening devices**


These devices are not intended for exit doors and should be used only in premises for a few people who have good knowledge of the premises. Examples are dwellings and small offices. The term other opening devices refers only to simple types of devices such as door handles and turn knobs.

Plastic domes over turn knobs are also covered here. These devices are intended to prevent unauthorised use of the turn knob function, e.g. in conjunction with installations for entry and exit control systems. Single action operation of the opening device should always be endeavoured.

## 4 Pairs of doors

Pairs of doors with an inactive leaf smaller than 500 mm, fitted with a door closer, are not recommended for use in escape routes where panic exit devices are required, because the resistance to opening is too great.

Automatic flush bolts shall not be used in inactive leaves where these form part of an escape route, because the automatic flush bolt does not have a sequentially activated opening function.

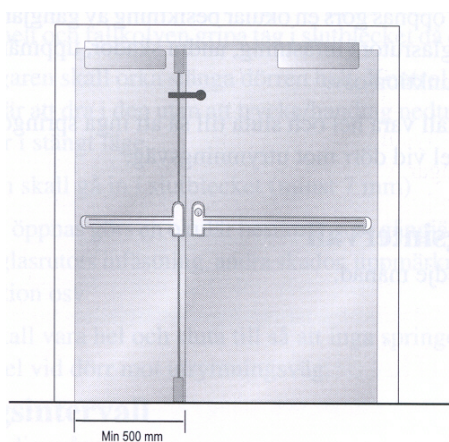

## 5 Emergency exit knob

Emergency exit knobs can be accepted where emergency exit devices in accordance with EN 179 are normally recommended according to Table 7.1. The knob shall be placed in a prominent position.

For activities where panic exit devices are recommended according to Table 7.1, emergency exit knobs shall not normally be accepted. In this type of activity, the use of an emergency exit knob shall be considered only after consultation with, and agreement by, the parties concerned.

Key switches are not accepted.

Properties of an emergency exit knob:

- Green encapsulation.
- The emergency exit box is to be marked with a special sign. This sign should be green with white text "Emergency exit". The sign should be large enough to be easily detected.
- The knob shall be easy to operate by a single action.
- The knob should be visible even in the event of power failure. This can be achieved by providing standby power to illuminate the sign, by making the knob luminous or the sign photoluminescence.
- Illuminated emergency exit knob. By means of an integral illumination function or some other lighting fitting.



- When the knob is depressed, the current shall be interrupted and the lock function released.
- If possible, red light for locked door and green light for unlocked door.
- The emergency exit knob can with advantage be equipped with an acoustic exit alarm.

Position of emergency exit knob:

- It shall be easy to see and placed on or in the immediate vicinity of the door.
- 0.9 – 1.2 m above floor level
- Max 0.5 m from the door laterally, but not on the side of the hinge.
- For single door the emergency exit knob shall be placed on the hinge side.
- For pairs of doors, push buttons should be placed beside the door to achieve the shortest distance between the emergency exit knob and the lever handle.

## **6 Intruder protection locking device**

If doors are fitted with intruder protection locking devices (night locks), further measures in the form of connecting these via microswitches or similar are required.

They shall be connected to the function essential for the activity in such a way that activity cannot be carried on in the premises until all escape routes have been unlocked. One usual way is to connect the lighting in such a way that it cannot be switched on until all escape routes have been unlocked.

Local regulations may allow for "night locking" when not open to the public or for general occupancy, under certain conditions. For example, it may be requested for each person having access to the building (such as cleaning, security or maintenance people) to have their own key allowing them to escape from the building in case of an emergency.

Special conditions, for instance when people are locked in for various reasons, are not dealt with here. In such cases the solutions must at all times be decided on in consultation with the parties concerned.

## **7 Operation and maintenance**

The doors and devices, which form part of escape routes, must be maintained so that their function in an emergency situation is secured.

Inspections shall be made at regular intervals by a person appointed by the person responsible for the building or firm. Inspection intervals are to be determined by the responsible person.

The way inspection is to be performed varies depending on the function, which the door has. See Appendix No 1.



## **8 Choice of exit device for locked door as a function of the activity**

Table 8.1 sets out the levels of exit devices in buildings and premises for different types of activities, where doors in escape routes are normally locked from the outside to prevent the entry of unauthorised persons.

In the table, premises which, regarding their size and the number of people present, may be compared to a place of assembly, e.g. a staff dining room or a school dining room, are equated with places of assembly. This means that the devices are designed for a larger number of people, with variable knowledge of the premises, than those engaged in the activity that is daily carried on in the premises.

The reason for the more stringent requirement in large office buildings, hotels and healthcare premises is that in an escape situation persons congregate in stairways from several floors. This means that so many persons congregate at the exits that a more secure exit function is necessary.

**In case of doubt the higher requirement shall at all times be selected, i.e. a panic exit device can always be used.**



### 8.1 Table for choosing exit devices

The fittings refer only to panic exit devices in accordance with EN 1125 or emergency exit devices in accordance with EN 179.

The numbers in the table heading refer to the corresponding examples of solutions in Appendix No 1.

Activity	Position of door	Panic exit device (EN 1125) Examples of solutions: <b>P1-P6</b> <b>PP1 – PP6*</b>	Emergency exit device (EN 179) Examples of solutions: <b>N1– N3</b> <b>NP1–NP3*</b>
<b>School &lt; 200 persons</b>	To stairway		X
	From stairway to external air		X
<b>School &gt; 200 persons</b>	To stairway		X
	From stairway to external air	X	
<b>Office building &lt;2000 m<sup>2</sup></b>	To stairway		X
	From stairway to external air		X
<b>Office building &gt; 2000 m<sup>2</sup></b>	To stairway		X
	From stairway to external air	X	
<b>Place of assembly</b>			
<b>Large number of people</b>	To foyer or stairway	X	
	Out to external air	X	
<b>Small number of people</b>	Out or to stairway		X
	From stairway to external air	X	
<b>Department store and retail trade &lt; 300 m<sup>2</sup> net floor space</b>	To external air or gallery		X
<b>Department store or retail trade &gt;300 m<sup>2</sup> net floor space</b>	To external air or gallery	X	
	From common gallery to external air	X	



Activity	Position of door	Panic exit device (EN 1125)  Examples of solutions: <b>P1-P6</b> <b>PP1 – PP6*</b>	Emergency exit device (EN 179)  Examples of solutions: <b>N1– N3</b> <b>NP1–NP3*</b>
<b>Hotel, except restaurant etc</b> <b>&lt; 200 beds</b>	To stairway		X
	From stairway to external air		X
<b>Hotel, except restaurant etc</b> <b>&gt; 200 beds</b>	To stairway		X
	From stairway to external air	X	
<b>Health care premises,</b> <b>&lt; 200 beds</b>	To stairway		X
	From stairway to external air		X
<b>Health care premises,</b> <b>&gt; 200 beds</b>	To stairway		X
	From stairway to external air	X	
<b>Service flats</b>	To stairway and to external air		X
<b>Alternative housing</b>	To stairway and to external air		X
<b>Day care centre</b>	To external air		X
<b>Industry</b>			X
<b>Warehouse</b>			X
<b>Laboratories etc with activity that presents a fire hazard</b>		X	

\* NP and PP denote pairs of doors



## 9 Definitions

- **Intruder protection locking**  
Locking device that complies with the insurer's intruder protection requirement for the premises concerned
- **Electromechanical door bolt**  
Electromechanical locking device which connects the top of the door leaf to the door frame through a mechanical coupling. It locks when connected to the power supply and is always automatically deactivated when disconnected from the power supply.
- **Standby power**  
Function that secures the supply of power in the event of mains failure. It is often provided in the form of a battery backup for e.g. electric striking plate, electromechanical door bolt, door holder magnet and entry and exit control system.
- **Electromechanical hold-open device**  
A hold-open device in the door closer function which is automatically deactivated when disconnected from the power supply. May also be provided in the form of a wall mounted door holder magnet.
- **Pulse generator**  
May be in the form of e.g. push button, key switch, microswitch in exit device, digital code lock, card reader, time switch, pulse from the alarm system or some other electrical function.
- **Door holder magnet**  
Electromechanical locking device which holds the top of the door leaf to the door frame through magnetic force. It locks when connected to the power supply and is always automatically deactivated when disconnected from the supply.
- **Automatic flush bolt**  
Locking device mounted on the meeting stile of the inactive leaf where its bolt is operated by a mechanism that is activated when the active leaf is closed.  
  
An automatic flush bolt must not be used in the inactive leaf when this is part of an escape route because the automatic flush bolt does not have a sequentially activated opening function.
- **Striking plate**  
Device mounted in the frame to reinforce this where the hole for a bolt is made.



- **Bolt**  
Mobile locking component placed in a lock or other locking device which shoots out through the forend, stile plate, etc.
- **Latch bolt**  
Bolt with a bevelled end.
- **Lever handle**  
Handle to operate the bolt of a lock.
- **Fire door**  
Door that has a certain period of resistance to fire. The period of fire resistance may vary depending on the position of the door or the fire resistance class of the surrounding elements of construction.
- **Tailpiece**  
For pairs of doors in combination with a door coordinator.

If a pair of doors is opened via the inactive leaf, the tailpiece opens the active leaf also, so long as the door coordinator has been activated, which means that the leaves will be closed in the right order

## 10 European guidelines

### *Fire*

Guideline No	1:2002 F	- Internal fire protection control
Guideline No	2:2013 F	- Panic & emergency exit devices
Guideline No	3:2011 F	- Certification of thermographers
Guideline No	4:2010 F	- Introduction to qualitative fire risk assessment
Guideline No	5:2003 F	- Guidance signs, emergency lighting and general lighting
Guideline No	6:2011 F	- Fire safety in care homes for the elderly
Guideline No	7:2011 F	- Safety distance between waste containers and buildings
Guideline No	8:2004 F	- Preventing arson – information to young people
Guideline No	9:2012 F	- Fire safety in restaurants
Guideline No	10:2008 F	- Smoke alarms in the home
Guideline No	11:2005 F	- Recommended numbers of fire protection trained staff
Guideline No	12:2012 F	- Fire safety basics for hot work operatives
Guideline No	13:2006 F	- Fire protection documentation
Guideline No	14:2007 F	- Fire protection in information technology facilities
Guideline No	15:2012 F	- Fire safety in guest harbours and marinas
Guideline No	16:2008 F	- Fire protection in offices
Guideline No	17:2008 F	- Fire safety in farm buildings
Guideline No	18:2013 F	- Fire protection on chemical manufacturing sites
Guideline No	19:2009 F	- Fire safety engineering concerning evacuation from buildings



- Guideline No 20:2012 F - Fire safety in camping sites
- Guideline No 21:2012 F - Fire prevention on construction sites
- Guideline No 22:2012 F - Wind turbines – Fire protection guideline
- Guideline No 23:2010 F - Securing the operational readiness of fire control system
- Guideline No 24:2010 F - Fire safe homes
- Guideline No 25:2010 F - Emergency plan
- Guideline No 26:2010 F - Fire protection of temporary buildings on construction sites
- Guideline No 27:2011 F - Fire safety in apartment buildings
- Guideline No 28:2012 F - Fire safety in laboratories

*Natural hazards*

- Guideline No 1:2012 N - Protection against flood
- Guideline No 2:2013 N - Business Resilience – An introduction to protecting your business

*Security*

- Guideline No 1:2010 S - Arson document
- Guideline No 2:2010 S - Protection of empty buildings
- Guideline No 3:2010 S - Security system for empty buildings
- Guideline No 4:2010 S - Guidance on key holder selections and duties



## 11 Appendix No: 1

# Appendix Panic & emergency exit devices

### FOREWORD

This Appendix offers technical solutions according to table 8.1 in the European Guide Line "Panic & emergency exit devices"

These technical solutions apply for exit doors, not sliding doors, both with and without a fire separating function, which shall normally be locked from the outside and/or provide the means of controlling the passage of persons from the inside/outside.

This Appendix has been compiled by Guidelines Commission and adopted by all fire protection associations in the Confederation of Fire Protection Associations Europe.

These technical solutions reflect best practice proposed by the members of CFPA Europe. Where the Guidelines and national requirements conflict, national requirements must apply.



### **11.1 DOOR N 1, Single fire door**

#### Fittings on the inside

Emergency exit device

Door closer. Can be fitted with electromechanical hold-open device

#### Functions on the inside

The exit handle, operated with one hand, secures exit

Option of authorised passage via a key


#### Fitting on the outside

Lever handle

#### Functions on the outside

Lever handle secures return

Option of authorised passage via a key

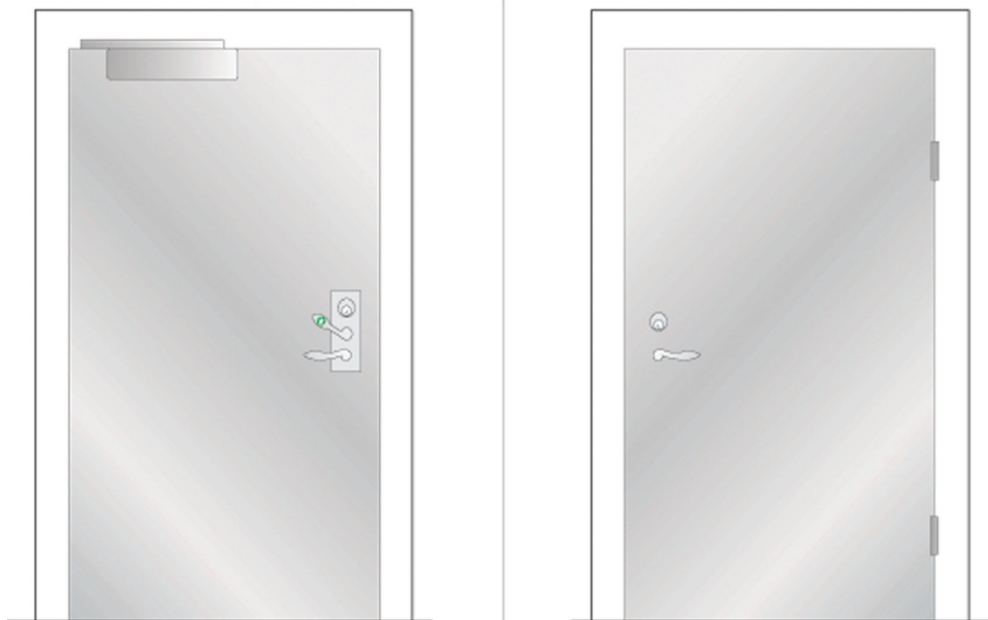

## **11.2 DOOR N 2, Single door, not a fire door**

### Fittings on the inside

Emergency exit button

Door holder magnet/electromechanical door bolt with standby power

Door closer. Can be fitted with electromechanical hold-open device

### Functions on the inside

Exit via emergency exit button

Option of authorised passage via key switch

Option of automatic unlocking via fire alarm. (Not as the only function)

### Fittings on the outside

Pull handle


Pulse generator, e.g. card reader

### Functions on the outside

Return via pull handle after exit or activation of fire alarm

Option of authorised passage via pulse generator

Option of automatic unlocking via fire alarm. (Not as the only function)

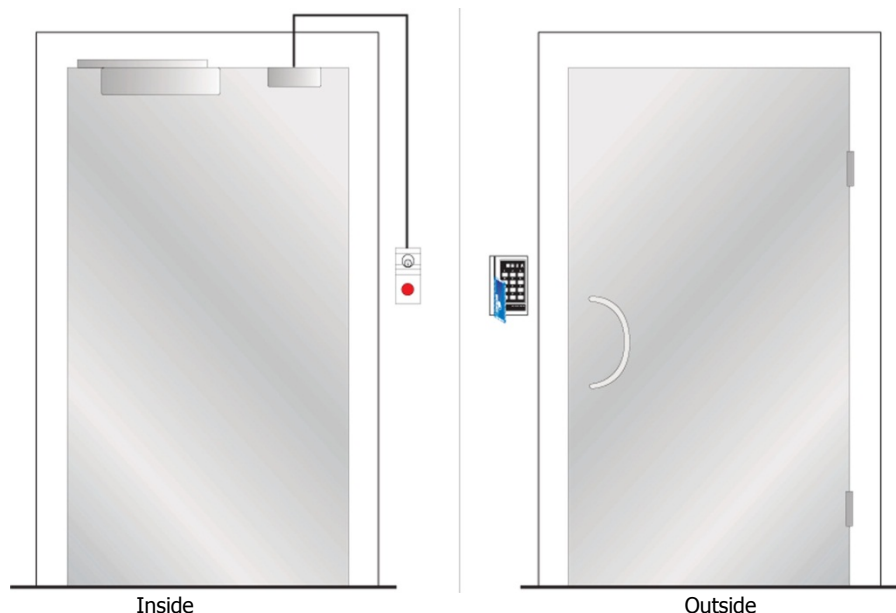



### 11.3 DOOR N 3, Single door with/without fire separating function depending on choice of electric striking plate

Standard  
EN

#### Fittings on the inside

Emergency exit device  
Electric striking plate  
Pulse generator, e.g. card reader  
Door closer

#### Functions on the inside


The exit handle, operated with one hand, secures exit  
Option of authorised passage via pulse generator/key  
Option of automatic unlocking via fire alarm, with fire separating function retained depending on choice of electric striking plate. (Not as the only function)

#### Fittings on the outside

Lever handle  
Pulse generator, e.g. card reader

#### Functions on the outside

Lever handle secures return  
Option of authorised passage via pulse generator/key  
Option of automatic unlocking via fire alarm, with fire separating function retained depending on choice of electric striking plate. (Not as the only function)

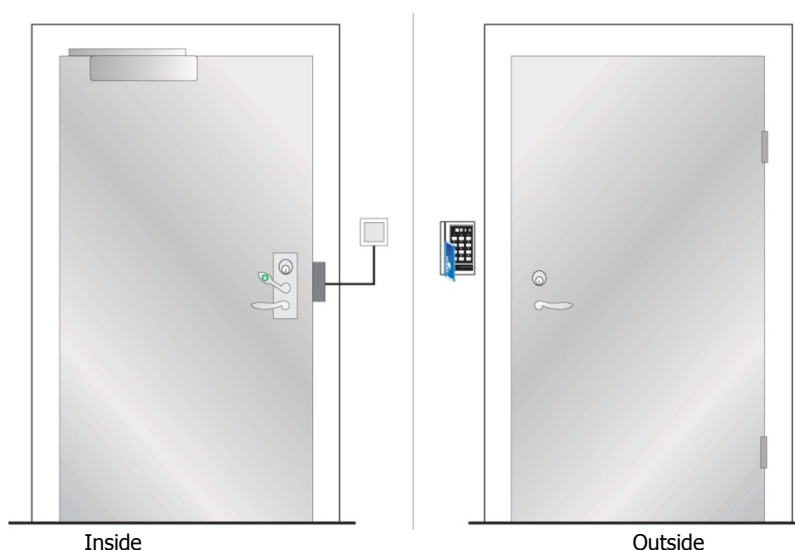



## 11.4 DOOR N 4, Single fire door

### Fittings on the inside

Emergency exit device, as push pad

Door closer. Can be fitted with electromechanical hold-open device

### Functions on the inside

The push pad, operated with one hand, secures exit

Option of authorised passage via a key

### Fitting on the outside


Option 1: See figure. Plain outside face

Option 2: Cylinder + pull handle

### Functions on the outside

Option 1: See figure. No return

Option 2: No return but authorised passage via key

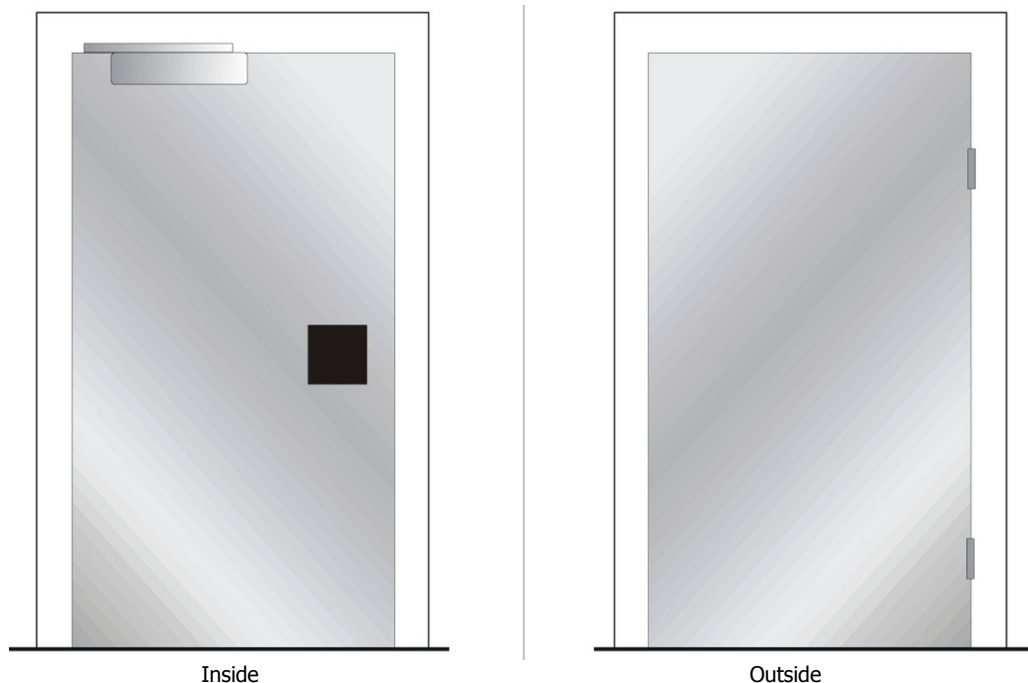



### **11.5 DOOR N 5, Single door with/without fire separating function depending on choice of electric striking plate**

#### Fittings on the inside

Emergency exit device as push pad  
Electric striking plate  
Pulse generator, e.g. card reader  
Door closer

#### Functions on the inside


The push pad, operated with one hand, secures exit  
Option of authorised passage via pulse generator/key  
Option of automatic unlocking via fire alarm, with fire separating function retained depending on choice of electric striking plate. (Not as the only function)

#### Fittings on the outside

Lever handle  
Pulse generator, e.g. card reader

#### Functions on the outside

No return but authorised passage via pulse generator/key  
Option of automatic unlocking via fire alarm, with fire separating function retained depending on choice of electric striking plate

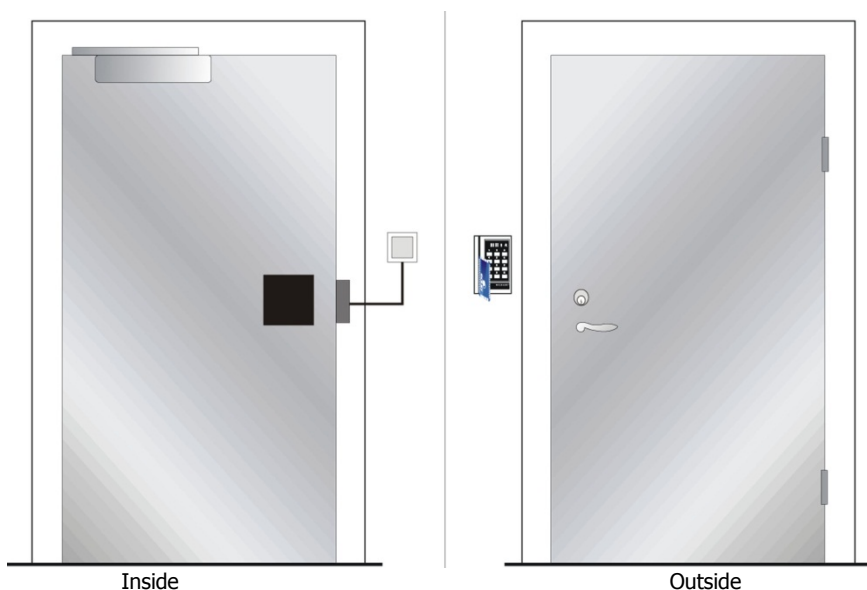



## **11.6 DOOR P 1, Single fire door**

### Fittings on the inside

Panic bolt

Door closer. Can be fitted with electromechanical hold-open device

### Functions on the inside

Panic bolt secures exit.

Option of authorised passage via key


### Fitting on the outside

Lever handle

### Functions on the outside

Lever handle secures return

Option of authorised passage via key

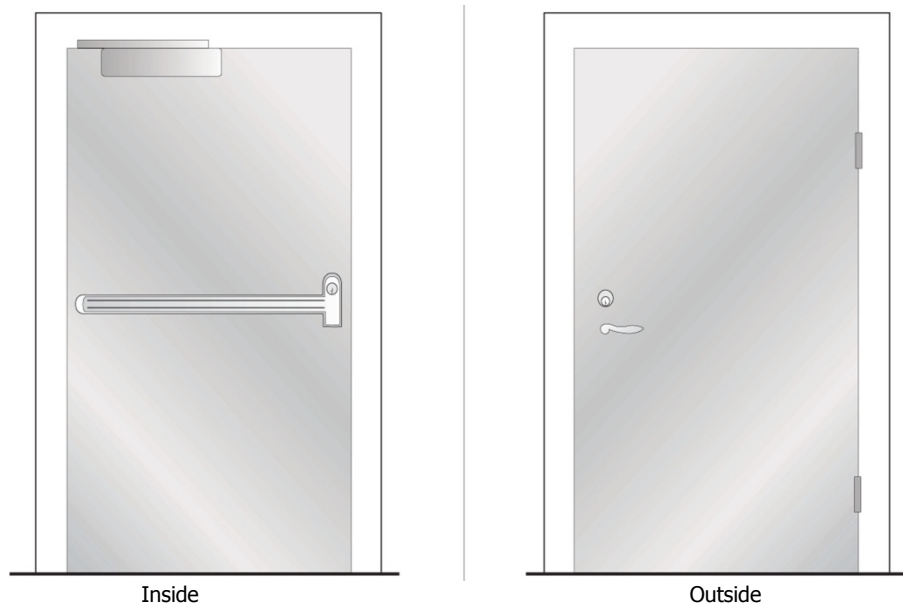



### **11.7 DOOR P 2, Single fire door**

#### Fittings on the inside

Panic bolt

Door closer. Can be fitted with electromechanical hold-open device

#### Functions on the inside

Panic bolt secures exit

Option of authorised passage via key

#### Fittings on the outside


Option 1: See figure. Plain outside face

Option 2: Cylinder + pull handle

#### Functions on the outside

Option 1: See figure. No return

Option 2: No return but authorised passage via key

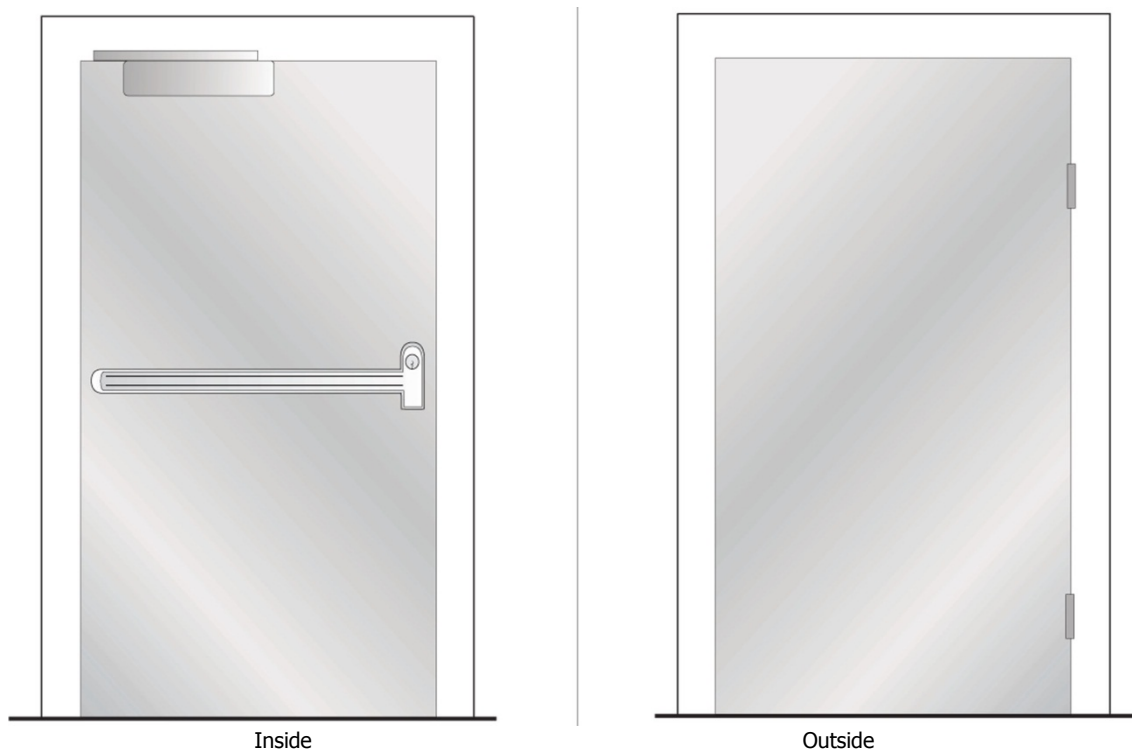

Option 1 of 2

### 11.8 DOOR P 3, Single fire door

#### Fittings on the inside

Panic bolt with micro switch

Door holder magnet/electromechanical door bolt

Door closer. Can be fitted with electromechanical hold-open device

#### Functions on the inside

Panic bolt secures exit

Micro switch secures opening of door holder magnet/electromechanical door bolt

Option of automatic unlocking via fire alarm, with fire separating function retained. (Not as the only function)

#### Fittings on the outside

Option 1: Lever handle

Option 2: See figure. Lever handle + pulse generator, e.g. card reader


#### Functions on the outside

Option 1: Lever handle secures exit

Option 2: See figure. Lever handle secures return

Option of authorised passage via pulse generator/key

Option of automatic unlocking via fire alarm, with fire separating function retained. (Not as the only function)

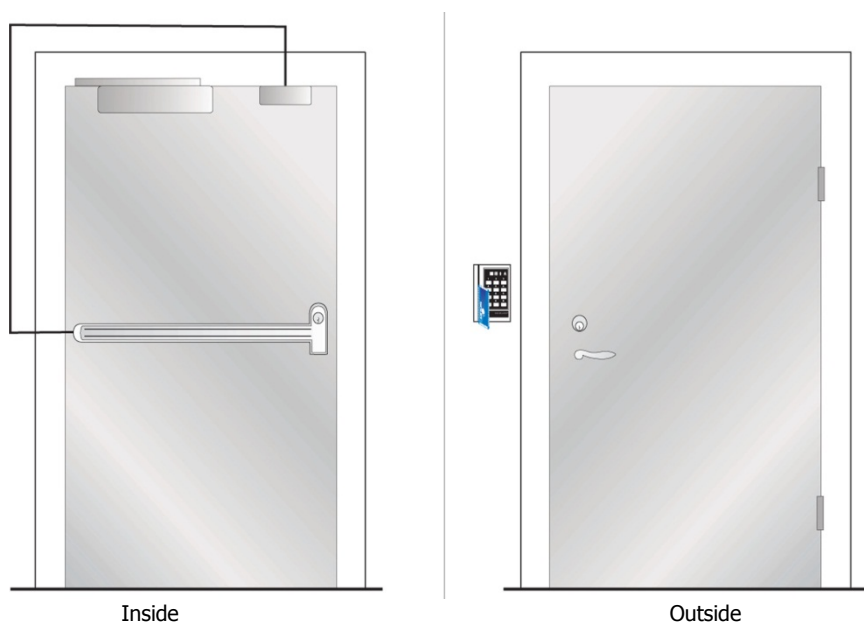

Option 2 of 2



### **11.9 DOOR P 4, Single door with/without fire separating function depending on choice of electric striking plate**

#### Fittings on the inside

Panic bolt  
Electric striking plate  
Pulse generator, e.g. card reader  
Door closer

#### Functions on the inside


Panic bolt secures exit  
Option of authorised passage via pulse generator  
Option of automatic unlocking via fire alarm, with fire separating function retained depending on choice of electric striking plate. (Not as the only function)

#### Fittings on the outside

Lever handle  
Pulse generator, e.g. card reader

#### Functions on the outside

Lever handle secures return  
Option of authorised passage via pulse generator  
Option of automatic unlocking via fire alarm, with fire separating function retained depending on choice of electric striking plate. (Not as the only function)

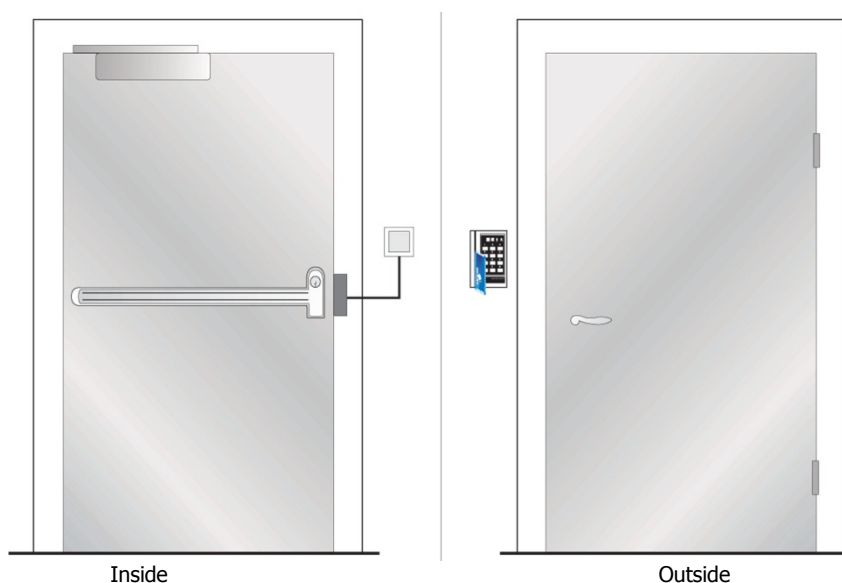

### **11.10 DOOR P 5, Single fire door**

#### Fittings on the inside

Panic bolt with electrical opening  
Pulse generator, e.g. card reader  
Door closer. Can be fitted with electromechanical hold-open device

#### Functions on the inside

Panic bolt secures exit  
Option of authorised passage via pulse generator

#### Fittings on the outside


Pull handle  
Pulse generator, e.g. card reader

#### Functions on the outside

No return  
Option of authorised passage via pulse generator

#### Note

The panic bolt shall not be electrically held open. It shall be electrically open only at the time of passage

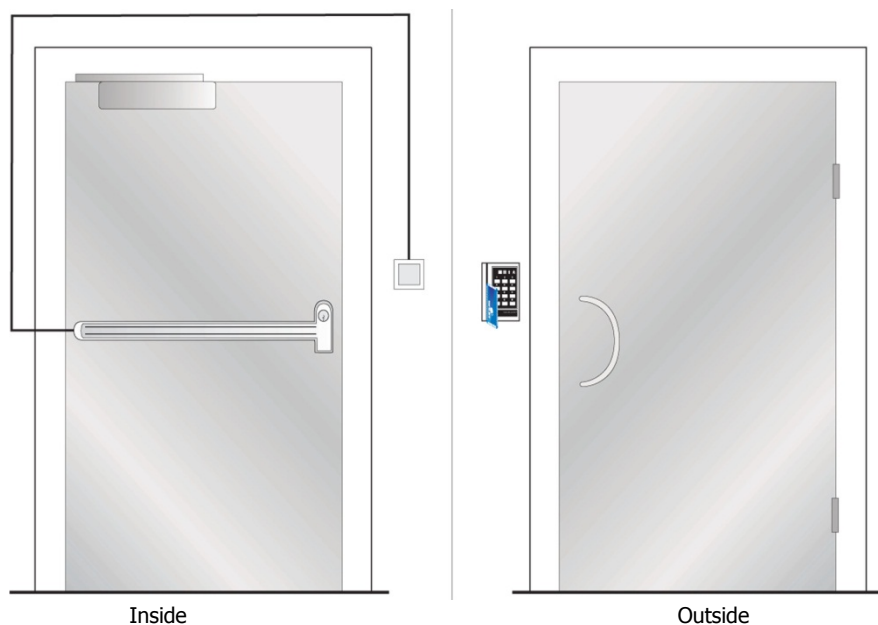

### **11.11 DOOR P 6, Single fire door**

#### Fittings on the inside

Panic bolt with electrical opening and micro switch  
 Door holder magnet/electromechanical door bolt  
 Pulse generator, e.g. card reader  
 Door closer. Can be fitted with electromechanical hold-open device

#### Functions on the inside

Panic bolt secures exit  
 Micro switch secures opening of door holder magnet/electromechanical door bolt  
 Option of authorised passage via pulse generator  
 Option of automatic unlocking via fire alarm, with fire separating function retained. (Not as the only function)

#### Fittings on the outside


Lever handle  
 Pulse generator, e.g. card reader

#### Functions on the outside

Lever handle secures return  
 Option of authorised passage via pulse generator  
 Option of automatic unlocking via fire alarm, with fire separating function retained. (Not as the only function)

#### Note

The panic bolt shall not be electrically held open. It shall be electrically open only at the time of passage  
 Can be fitted with door automatics

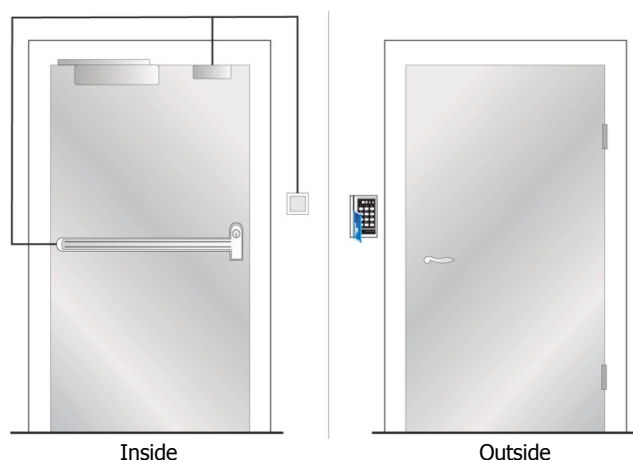



### **11.12 DOOR NP 1, Pair of fire doors**

#### Fittings on the inside

Emergency exit devices, active leaf

Automatic flush bolts, inactive leaf

Inactive leaf fitted with tailpiece for the door coordinator function

#### Functions on the inside

Exit handle, operated with one hand, secures exit via active leaf

Option of authorised passage via key

#### Fittings on the outside

Lever handle

Door closer with coordinator. Can be fitted with electromechanical hold-open device

#### Functions on the outside


Lever handle secures return

Option of authorised passage via key

Door closer with coordinator closes the leaves in the right order

#### Note

The inactive leaf shall not form part of the escape route

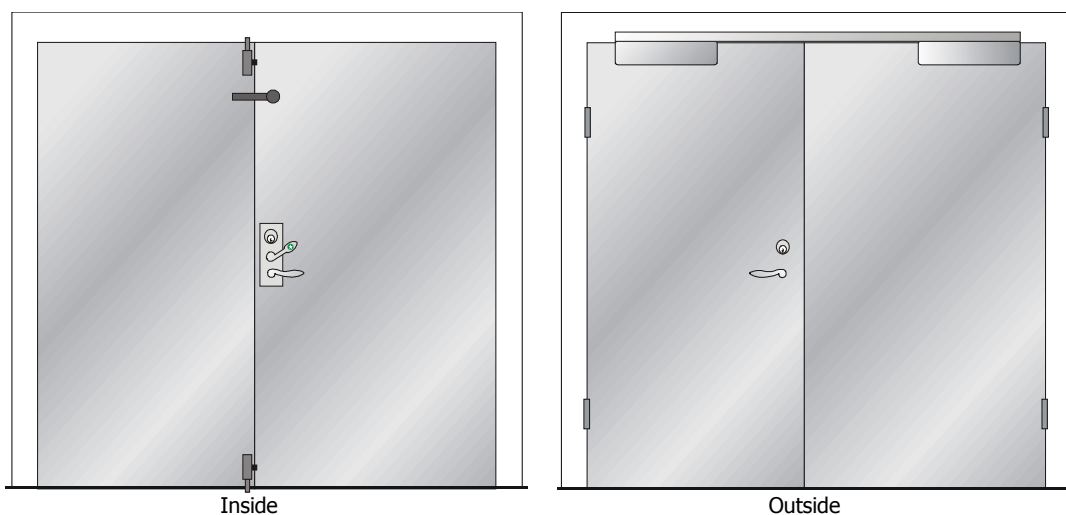



### **11.13 DOOR NP 2, Pair of doors with no fire separating function**

#### Fittings on the inside

Emergency exit button

Option 1: See figure. Rebated doors fitted with door holder magnet/electromechanical door bolt with standby power

Inactive leaf fitted with tailpiece for the door coordinator function

Option 2: Not rebated doors fitted with double door holder magnets/ electromechanical door bolts with standby power

#### Functions on the inside

Exit via emergency exit button

Option of authorised passage via key switch

Option of automatic unlocking via fire alarm. (Not as the only function)

#### Fittings on the outside

Pull handle

Pulse generator, e.g. card reader

Option 1: See figure. Rebated doors fitted with door closer and coordinator

Can be fitted with electromechanical hold-open device

Option 2: Not rebated doors fitted with door closer. Coordinator not required. Can be fitted with electromechanical hold-open device


#### Functions on the outside

Return via pull handle after exit or activation of fire alarm

Option of authorised passage via pulse generator

Option of automatic unlocking via fire alarm. (Not as the only function)

Door closer with coordinator closes the leaves in the right order

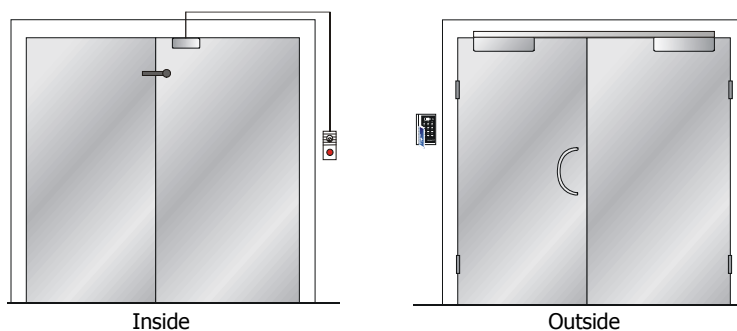

Option 1 of 2



### 11.14 DOOR NP 3, Pair of doors with/without fire separating function depending on choice of electric striking plate

#### Fittings on the inside

Emergency exit device  
 Electric striking plate in inactive leaf  
 Pulse generator, e.g. card reader  
 Automatic flush bolts in inactive leaf  
 Inactive leaf fitted with tailpiece for the door coordinator function

#### Functions on the inside

Exit handle secures exit via active leaf  
 Option of authorised passage via pulse generator/key  
 Option of automatic unlocking via fire alarm, with fire separating function retained, depending on choice of electric striking plate. (Not as the only function)

#### Fittings on the outside


Lever handle  
 Pulse generator, e.g. card reader  
 Door closer with coordinator

#### Functions on the outside

Lever handle secures return  
 Option of authorised passage via pulse generator/key  
 Door closer with coordinator closes the leaves in the right order  
 Option of automatic unlocking via fire alarm, with fire separating function retained, depending on choice of electric striking plate. (Not as the only function)

#### Note

Inactive leaf shall not form part of the escape route

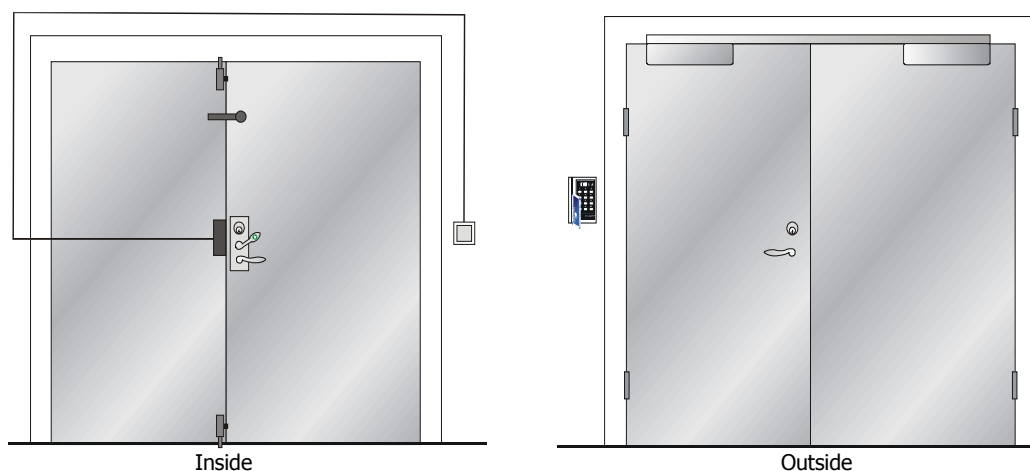

### **11.15 DOOR NP 4, Pair of fire doors**

#### Fittings on the inside

Emergency exit devices, as push pad

Automatic flush bolts, inactive leaf

Inactive leaf fitted with tailpiece for the door coordinator function

#### Functions on the inside

Push pad secures exit via active leaf

Option of authorised passage via key

#### Fittings on the outside

Option 1: See figure. Plain outside face

Door closer with coordinator. Can be fitted with electromechanical hold-open device

Option 2: Cylinder + pull handle

Door closer with coordinator. Can be fitted with electromechanical hold-open device

#### Functions on the outside

Option 1: See figure. No return


Door closer with coordinator closes the leaves in the right order

Option 2: No return but authorised passage via key

Door closer with coordinator closes the leaves in the right order

#### Note

Inactive leaf shall not form part of the escape route

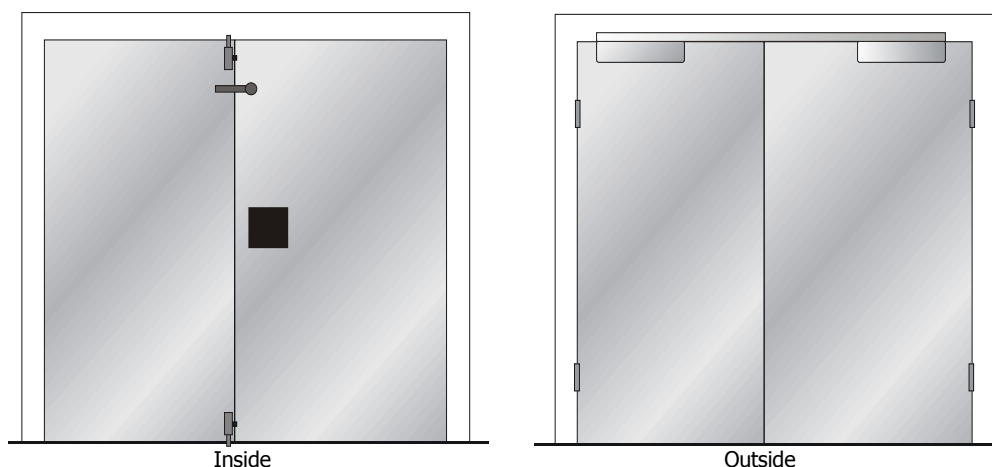



### 11.16 DOOR NP 5, Pair of doors with/without fire separating function depending on choice of electric striking plate

#### Fittings on the inside

Emergency exit device, as push pad  
 Electric striking plate in inactive leaf  
 Pulse generator, e.g. card reader  
 Automatic flush bolts in inactive leaf  
 Inactive leaf fitted with tailpiece for the door coordinator function

#### Functions on the inside

The push pad secures exit via active leaf  
 Option of authorised passage via pulse generator/key  
 Option of automatic unlocking via fire alarm, with fire separating function retained, depending on choice of electric striking plate. (Not as the only function)

#### Fittings on the outside


Pull handle  
 Pulse generator, e.g. card reader  
 Door closer with coordinator

#### Functions on the outside

No return but authorised passage via pulse generator/key  
 Door closer with coordinator closes the leaves in the right order  
 Option of automatic unlocking via fire alarm, with fire separating function retained depending on choice of electric striking plate. (Not as the only function)

#### Note

Inactive leaf shall not form part of the escape route

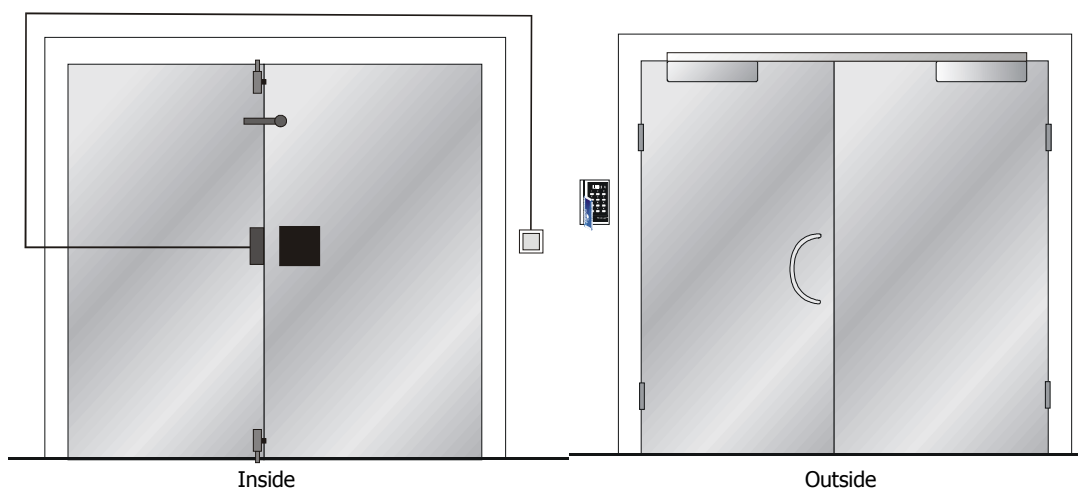



### **11.17 DOOR PP 1, Pair of fire doors**

#### Fittings on the inside

Panic bolts

Inactive leaf fitted with tailpiece for the door coordinator function

#### Functions on the inside

Panic bolt secures exit

Option of authorised passage via key

#### Fittings on the outside

Lever handle

Door closer with coordinator. Can be fitted with electromechanical hold-open device

#### Functions on the outside

No return

Option of authorised passage via key

Door closer with coordinator closes the leaves in the right order

#### Note

Where the inactive leaf forms part of the escape route, its width shall not be less than 500 mm.



### **11.18 DOOR PP 2, Pair of fire doors**

#### Fittings on the inside

Panic bolts

Inactive leaf fitted with tailpiece for the door coordinator function

#### Functions on the inside

Panic bolt secures exit

Option of authorised passage via key

#### Fittings on the outside

Door closer with coordinator. Can be fitted with electromechanical hold-open device

Option 1: See figure. Plain outside face

Option 2: Cylinder + pull handle

#### Functions on the outside


Door closer with coordinator closes the leaves in the right order

Option 1: See figure. No return

Option 2: No return but authorised passage via key

#### Note

Where the inactive leaf forms part of the escape route, its width shall not be less than 500 mm.

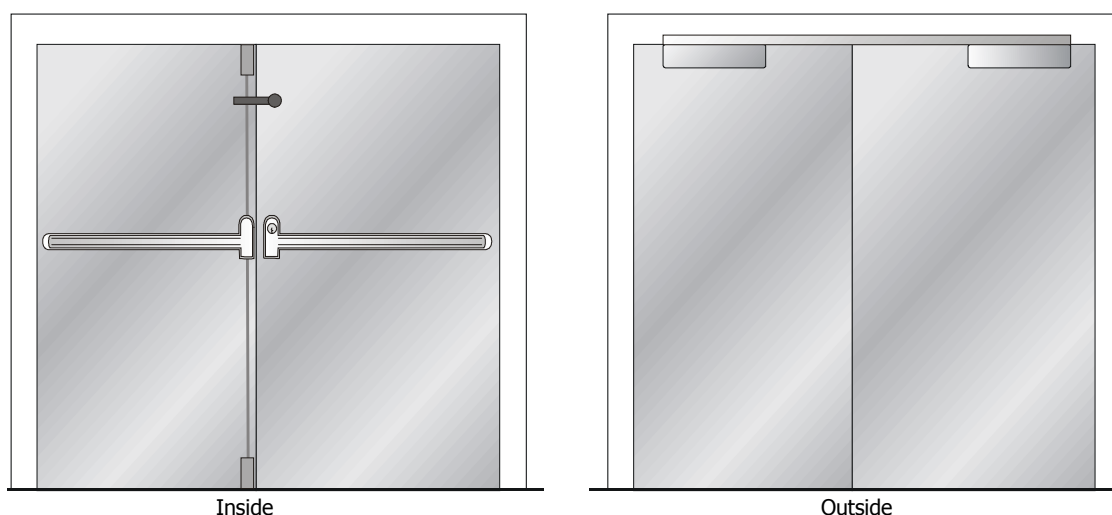

Option 1 of 2

### 11.19 DOOR PP 3, Pair of fire doors

#### Fittings on the inside

Panic bolts with micro switches

Door holder magnet/electromechanical door bolt in active leaf

Inactive leaf fitted with tailpiece for the door coordinator function

#### Functions on the inside

Panic bolts secure exit

Micro switches secure opening of door holder magnet/electromechanical door bolt

Option of automatic unlocking via fire alarm, with fire separating function retained, depending on choice of electric striking plate. (Not as the only function)

#### Fittings on the outside

Door closer with coordinator. Can be fitted with electromechanical hold-open device

Option 1: Lever handle

Option 2: See figure. Lever handle + pulse generator, e.g. card reader

#### Functions on the outside

Door closer with coordinator closes the leaves in the right order

Option 1: Lever handle secures return


Option 2: See figure. Lever handle secures return

Option of authorised passage via pulse generator/key

Option of automatic unlocking via fire alarm, with fire separating function retained. (Not as the only function)

#### Note

Where the inactive leaf forms part of the escape route, its width shall not be less than 500 mm

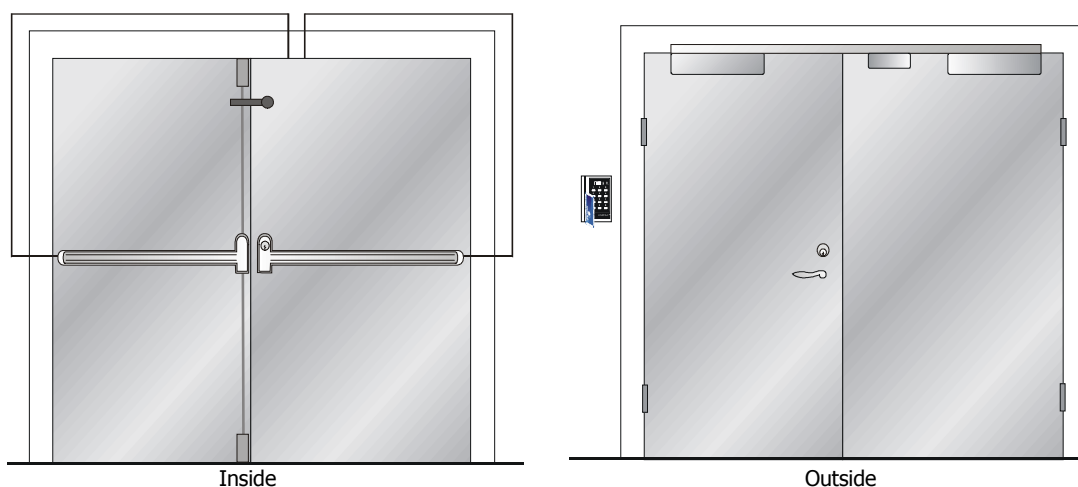

Option 2 of 2



### 11.20 DOOR PP 4, Pair of doors with/without fire separating function depending on choice of electric striking plate

#### Fittings on the inside

Panic bolts with micro switches  
 Electric striking plate in inactive leaf  
 Pulse generator, e.g. card reader  
 Inactive leaf fitted with tailpiece for the door coordinator function

#### Functions on the inside

Panic bolts secure exit  
 Option of authorised passage via pulse generator  
 Option of automatic unlocking via fire alarm, with fire separating function retained, depending on choice of electric striking plate. (Not as the only function)

#### Fittings on the outside


Lever handle  
 Pulse generator, e.g. card reader  
 Door closer with coordinator

#### Functions on the outside

Lever handle secures return. (Depending on choice of electric striking plate)  
 Option of authorised passage via pulse generator  
 Option of automatic unlocking via fire alarm, with fire separating function retained, depending on choice of electric striking plate. (Not as the only function)  
 Door closer with coordinator closes the leaves in the right order

#### Note

Where the inactive leaf forms part of the escape route, its width shall not be less than 500 mm.

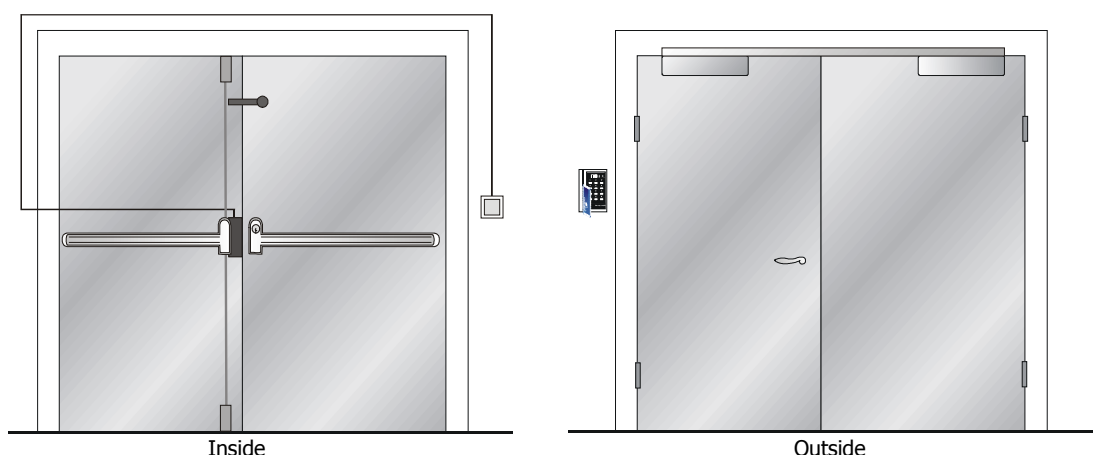

### **11.21 DOOR PP 5, Pair of fire doors**

#### Fittings on the inside

Panic bolts with electrical opening  
Pulse generator, e.g. card reader  
Inactive leaf fitted with tailpiece for the door coordinator function

#### Functions on the inside

Panic bolts secure exit  
Option of authorised passage via pulse generator

#### Fittings on the outside


Pull handle  
Pulse generator, e.g. card reader  
Door closer with coordinator. Can be fitted with electromechanical hold-open device

#### Functions on the outside

No return  
Option of authorised passage via pulse generator  
Door closer with coordinator closes the leaves in the right order

#### Note

Where the inactive leaf forms part of the escape route, its width shall not be less than 500 mm.  
Panic bolt shall not be electrically held open. It shall be electrically open only at the time of passage

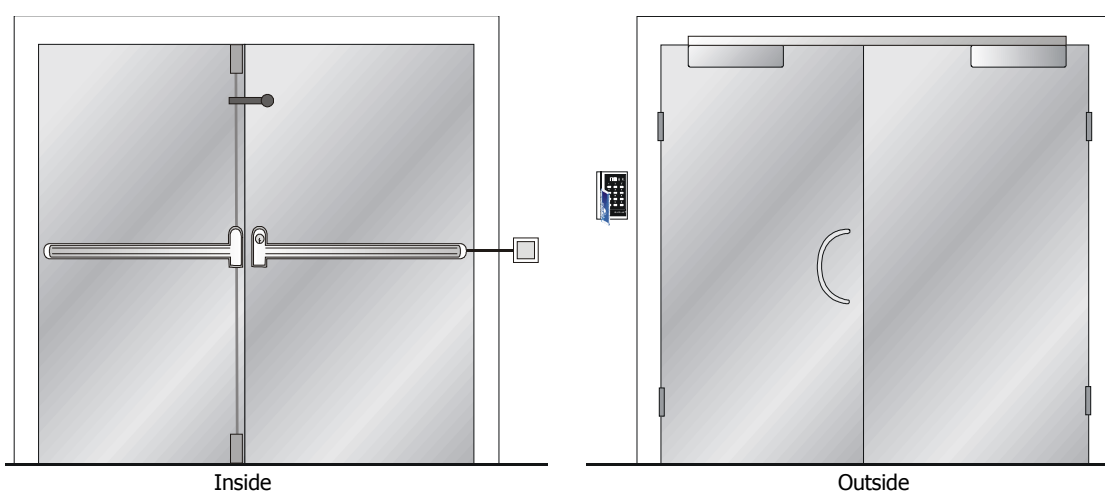

## 11.22 DOOR PP 6, Pair of fire doors

### Fittings on the inside

Panic bolts with electrical opening and micro switches  
 Door holder magnet/electromechanical door bolt in active leaf  
 Pulse generator, e.g. card reader  
 Inactive leaf fitted with tailpiece for the door coordinator function

### Functions on the inside

Panic bolts secure exit  
 Micro switch secures opening of door holder magnet/electromechanical door bolt  
 Option of authorised passage via pulse generator  
 Option of automatic unlocking via fire alarm, with fire separating function retained, depending on choice of electric striking plate. (Not as the only function)

### Fittings on the outside


Lever handle  
 Pulse generator, e.g. card reader  
 Door closer with coordinator. Can be fitted with electromechanical hold-open device

### Functions on the outside

Lever handle secures return  
 Option of authorised passage via pulse generator  
 Door closer with coordinator closes the leaves in the right order  
 Option of automatic unlocking via fire alarm, with fire separating function retained. (Not as the only function)

### Note

Where the inactive leaf forms part of the escape route, its width shall not be less than 500 mm.  
 Panic bolt shall not be electrically held open. It shall be electrically open only at the time of passage.  
 Can be fitted with door automatics

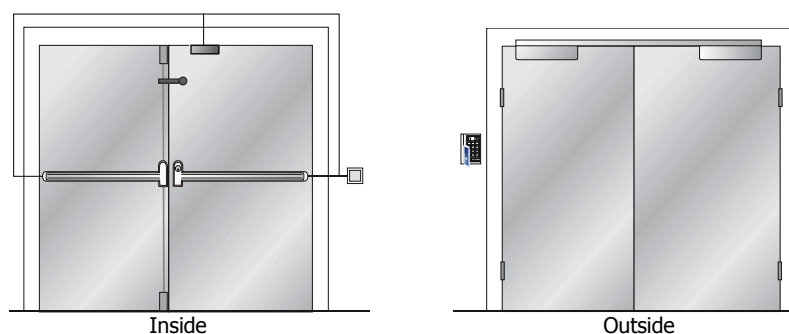



## 12 EXAMPLES OF CONTROL ROUTINES

Regular control should be carried out by the usufructuary, but an effort should be made to perform the control together with the property owner as often as possible. The aim of this is to become familiar with the building and to form an overall idea of the total security of escape, and to achieve a good dialogue with the property owner.

In order that control of the technical installation may be carried out in a satisfactory manner, the following checklist should be used in checking doors in, and to, an escape route.

How often controls should be carried out depends on the hazard situation and the general wear and tear in the building and premises. Control of escape facilities should be made every day.

### 12.1 Control routines

**For all doors in and to escape routes, regardless of whether they have, or have not, a fire compartment separating function, the following are to be checked.**

#### Function

- Check that the door can be easily opened without a key, code or card, and that it can be opened at least 90°
- Check that nothing is blocking the escape route
- Check that the force needed to open the door does not exceed 130 N (ca 13 kgf)
- Check that return into the premises is possible where so required

#### Maintenance

- When the door is opened, make a visual inspection of hinges, locks, handle, door frame, the attachment of glazed panels if any, any other damage, marking, the function of the door handle, etc

**For a door with a fire compartment separating function, the following is also to be checked**

#### Gastightness

- Check that the door is undamaged and closes so that there are no gaps, not even along the doorstep of a door opening into an escape route in a stairway
- Check that any intumescent strips that are fitted along the door are undamaged

#### Lock case

- A lock case with only a cylinder lock must not be fitted with a hold-open device
- Check the engagement of the spring bolt with the striking plate
  - Door of fire resistance class E/EI 30 - 7 mm
  - Door of fire resistance class E/EI 60 - 10 mm



**Foor doors that also have the following components fitted, the following shall also be checked:**

**Door closer**

- Open door ca 10 cm and let it go. Check that the door closes completely and that the spring bolt engages with the striking plate
- Check if there are any oil leaks
- Check for damage to the arm system that affects the door holder function
- Check the fixing of the door closer housing and the fixings of the arms
- NOTE that split-arm system or hold-open arms are not recommended for doors at fire compartment boundaries

**Electromechanical hold-open device**

- Break the current, e.g. with the test button
- Check that the door closes completely and that the spring bolt engages with the striking plate
- Check that it is released in the event of power failure

**Automatic flush bolt for double doors**

- Check that the flush bolt moves easily in the striking plate
- Pull the handle and check that the doors do not open
- Check the fixing of the flush bolt and striking plate

**Coordinator for double doors**

- Check that the "correct" door closes first
- Check the fixing

**Tailpiece for double doors**

- Check fixing and function

**Guidance marking**

- Assess whether the sign is fully visible from appropriate points in the premises
- Check that the sign is in place and that it is functioning, i.e. it is undamaged, illuminated, not concealed
- Check the emergency power supply, if any. This can be done on fluorescent signs with their own backup battery. Press the button on the light fitting or unscrew the fuse that supplies the light fitting, and check the emergency light